

TABLE OF CONTENTS

IIIII UUUUGUUII	3
Pre-Construction Details	
Safety	
Drainage	
Base Pad	
Disclaimer	
Block Specifications	
Block Specifications	
Installation Basics	
Wall Stability	
Setting Into Hills	
Corners	_
Outside Corner	
Inside Corner	
Key Blocks	
Straight Walls	
Inside-Outside	
Outside-Outside	
Inside-Inside	
Full Circles	
Curves	13
Inside Curves	14
Inside-Outside	
Outside -Outside	
Inside-Inside	
Outside Curves	
Inside-Outside	
Outside-Outside	
Inside-Inside	
Grid	_
Installation	
CornersCurves	
Geo-Grip	
Base Blocks	
Steps	21
Fencing	22
Terracing	

JC	awaii5	ZJ
Fii	nishing off your wall	2 4
	Recess Blocks	24
	Top Caps	25
Pr	oduct Specification Guide	26
Pa	rt 1: General	26
	1.1 Section Includes	
	1.2 Related Requirements	26
	1.3 Reference Standards	26
	1.4 Preinstallation Meetings	27
	1.5 Submittals	
	1.6 Quality Assurance	28
	1.7 Delivery, Storage, and Handling	28
Pa	rt 2: Products	29
	2.1 Design Criteria	
	2.2 Concrete Landscape Blocks	
	2.3 Soil	
	2.4 Geogrid Soil Reinforcement	31
	2.5 Geotextile Filter Fabric	
	2.6 Drainage collection Pipe	34
Pa	rt 3: Execution	34
	3.1 Examination	
	3.2 General	34
	3.3 Excavation	
	3.4 Base Leveling Pad	
	3.5 Concrete Landscape Block Installation	
	3.6 Geotextile Filter Fabric	
	3.7 Geogrid Soil Reinforcement Installation	
	3.8 Reinforced Backfill Placement	
	3.9 Tolerances	
	3.10 Field Quality Control	
	3 11 Drotaction	27

INTRODUCTION

Welcome to the LedgeRock Commercial Wall System! LedgeRock's unique, modular precast design allows walls to be installed easily and efficiently by contractors, offering a lower-cost option than cast-in-place walls. No on-site forming. No expensive concrete pumping equipment. Wall units are delivered at the specified strength and don't require additional cure time.

LedgeRock offers alternative site solutions to other systems by allowing for higher walls without the use of grid reinforcement. For walls greater than the maximum gravity wall height both a traditional friction-fit grid connection and our patented Geo-Grip mechanical connection options are available. Refer to the charts in the back of the manual for suggested gravity wall and reinforcement charts. Please note that these are suggested guides only. All walls require site-specific engineering. Most municipalities also require a building permit and site specific engineering for walls over 4 ft. tall.

PRE-CONSTRUCTION DETAILS

Before construction, a few details must be planned to ensure safe construction.

SAFETY

LedgeRock's number one goal is always user safety both during construction and thereafter. Always follow all local, state and federal building codes during installation. In addition, a Professional Engineer (P.E.) must be placed in charge of design for every LedgeRock project. Follow all site specific considerations your engineer specifies.

DRAINAGE

The presence of water around a retaining wall can dramatically reduce the abilities of your wall. It is crucial to take into account the presence of any water behind your wall, and provide adequate drainage for it. This is the job for your Professional Engineer. Reference the Product Specification Guide, Section 2.6 on page 40.

BASE PAD

A solid wall starts with a solid foundation. Building your wall on an unsuitable base will likely have drastic consequences. See sections 2.3 and 3.4 of the Product Specification Guide on pages 37 and 41 respectively.

DISCLAIMER

The design is for internal stability of LedgeRock structures only. External stability, including, but not limited to, foundation and slope stability is the responsibility of the owner. These designs are based on the assumption of proper installation by LedgeRock's specifications.

To the best of our knowledge, these drawings accurately represent product use in the applications shown. These drawings are to be used for conceptual, instructional, and estimating purposes only. Anyone using these drawings does so at their own risk and assumes all liability for such use. Final construction design must be performed by a registered Professional Engineer who is familiar with the product and who has taken into account the specific site conditions.

BLOCK SPECIFICATIONS

28" Full Unit

Size 28x24x48 Weight 2474 lbs Coverage 8 ft²



Key Block

Size 28x24x44 Weight 2558 lbs Coverage 7.33 ft²



LH Corner Unit

Size 28x24x52 Weight 2717 lbs Coverage 12 ft²



RH Corner Unit

Size 28x24x52 Weight 2717 lbs Coverage 12 ft²



LH Half Corner

Size 28x24x28 Weight 1406 lbs Coverage 9.33 ft²



RH Half Corner

Size 28x24x28 Weight 1406 lbs Coverage 9.33 ft²



52" Full Unit

Size 52x24x48 Weight 4400 lbs Coverage 8 ft²



52" Half Unit

Size 52x24x24 Weight 1890 lbs Coverage 4 ft²



52" Full Base Unit

Size 52x24x48 Weight 4500 lbs Coverage 8 ft²



52" Half Base Unit

Size 52x24x24 Weight 1990 lbs Coverage 4 ft²



BLOCK SPECIFICATIONS

28" Half Unit

Size 28x24x24 Weight 1173 lbs Coverage 4 ft²



Full Recessed Cap

Size 28x24x48 Weight 2025 lbs Coverage 8 ft²



Recessed Key Cap

Size 28x24x44 Weight 1,670 lbs Coverage 7.33 ft²



Half Recessed Cap

Size 28x24x24 Weight 966 lbs Coverage 4 ft²



LH Recessed Corner Cap

Size 28x24x52 Weight 2306 lbs Coverage 12 ft²



RH Recessed Corner Cap

Size 28x24x52 Weight 2306 lbs Coverage 12 ft²



LH Half Recessed Corner Cap

Size 28x24x28 Weight 1289 lbs Coverage 8 ft²



RH Half Recessed Corner Cap

Size 28x24x28 Weight 1289 lbs Coverage 8 ft²




■ INSTALLATION AND ENGINEERING MANUAL

Notes:	

INSTALLATION BASICS


WALL STABILITY

To protect against tipping, LedgeRock walls require each course to step back 2 inches. LedgeRock are designed with this in mind having the bottom trough offset two inches from the top knobs. This 2 inch step back is a critical design feature that must be featured in every LedgeRock project.

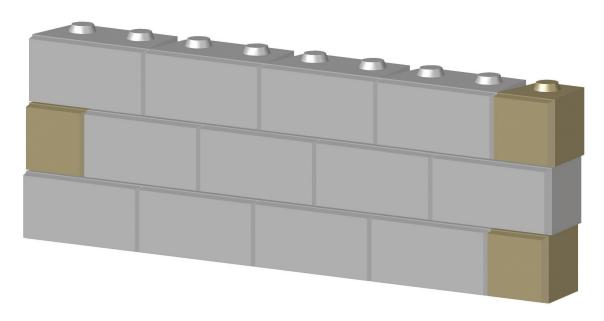


SETTING INTO HILLS

When setting your blocks into a hill, remember to keep a good base undeneath all your blocks. A few blocks will barely be visible, but are critical to the wall's stability.

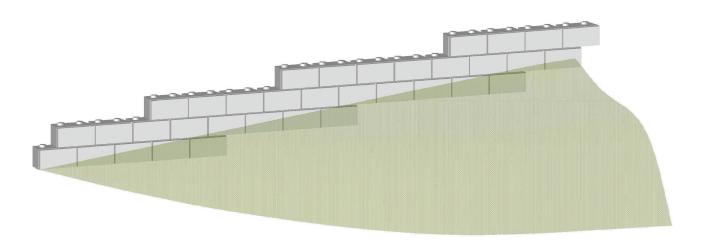

CORNERS

There are two different types of corners you can build with LedgeRock - inside corners and outside corners. Each is made differently, using different blocks.

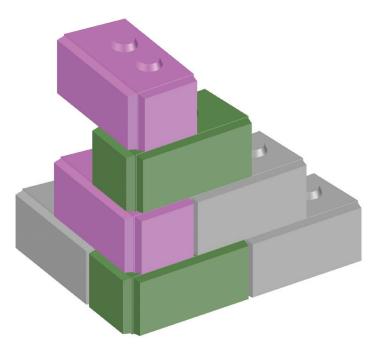



OUTSIDE CORNER


The outside corner is made by alternating Left and Right Outside Corner Blocks on each successive course. Remember that each Corner Block will be placed back 2 inches in both directions to account for the wall's setback.

INSIDE CORNER

To make an inside corner, you'll need an Inside Corner Blockout, and a Rubber Knob Blockout. Because of the geometry of inside corners, the inside knob of each corner block must be blocked out (except on the top course). To compensate, use construction adhesive to lock the block in place. Overlap one Left or Right Inside Corner Block successively on each course to make the corner.






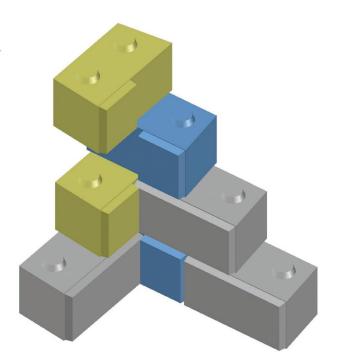

KEY BLOCKS


Key Blocks are 44 inches long, 4 inches shorter than the standard Full Unit. These are used to account for a change in course length due to your wall's features, i.e. corners and curves. The amount and placement of Key Blocks you need depends on what features your wall has. Each situation is different, and is explained in detail throughout this manual.

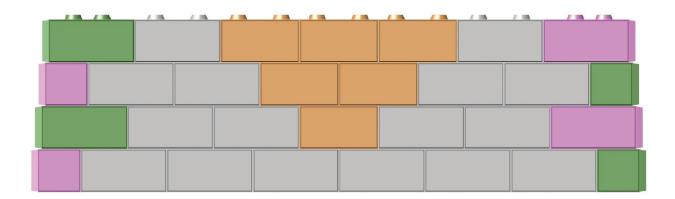




STRAIGHT WALLS

A straight wall is built differently based upon what corner pairings you use: two inside corners, two outside corners, or one of each.

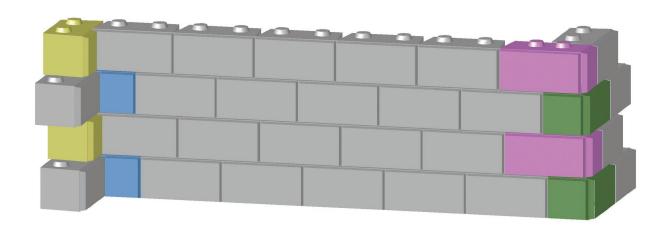


INSIDE-OUTSIDE

The inside-outside is the easiest corner pairing to build, because there is no need to use Key Blocks in the wall. Simply use your standard Full Units, combined with Inside and Outside Corner Blocks, to create your wall. Remember that each course must step back 2 inches.

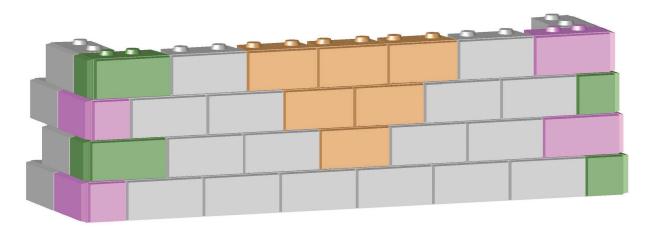

OUTSIDE-OUTSIDE

The outside corner on either side of the outside-outside corner pairing steps in 2 inches to adjust for the wall running in the other direction. As a result your wall gets squeezed in 4 inches on every course going up. Correcting this problem requires the use of Key Blocks. The bottom layer does not require a Key Block; however, as you build up, each successive course will require one additional Key Block. Your second row will require 1 Key Block, your third row 2, and so on. At 12 courses the wall is squeezed 48 inches and does not require a Key Block, then simply start the pattern over again.

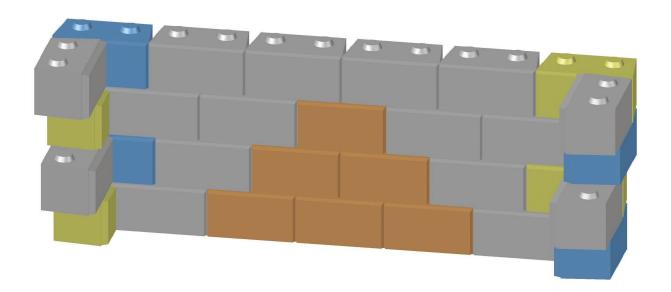


INSIDE-INSIDE

The inside-inside corner pairing is similar to the outside-outside, but is, in a way, opposite. The inside corner on either side steps out 2 inches to adjust for the wall running in the other direction. As a result, your wall gets squeezed in 4 inches on every course going down. This problem, again, requires the use of Key Blocks. The top layer of your wall will not require a Key Block. However, each successive layer down will require one additional Key Block. For this reason, a precise plan of the wall must be fashioned before construction.




FULL CIRCLES

Using Tapered End Inserts allows your LedgeRock to create a perfect circle. The tightest circle you can make with standard Full Blocks will have an outside radius of 16 feet, and an inside radius of 14 feet. Notice that if you're stacking several courses of full circles, the top course must be designed with the smallest diameter. Of course, larger diameters can be made by simply using more blocks in your circle.

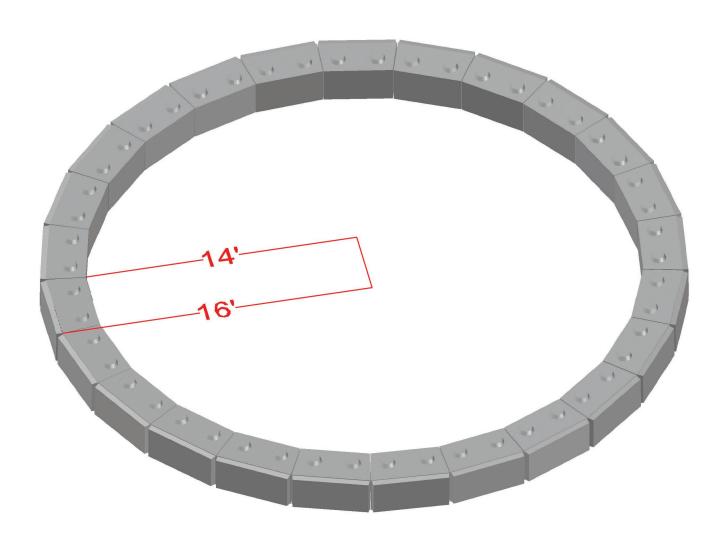


CURVES

Curves present design challenges not found in straight walls. This is because of the changing radius of curves, regardless of the corner pairing. The easiest way to prevent problems is to have one or two free ends on your curve to allow the change in length of each course.

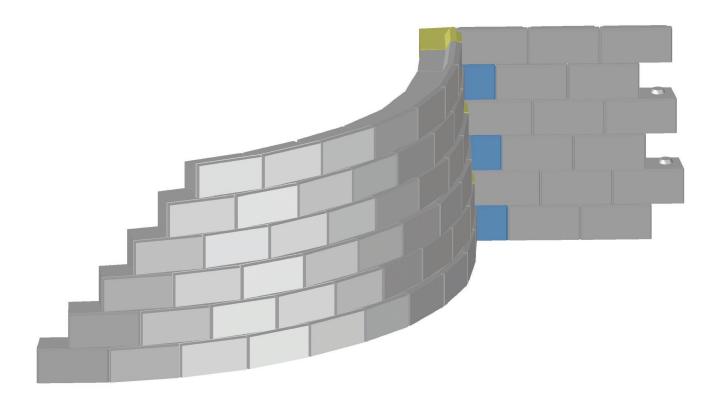


INSIDE CURVES

Because each course steps back 2 inches, the radius of an inside curve becomes larger. This makes the length of each successive course slightly larger. This will leave a gap at the end of the course. Due to the nature of curves, this change in length is very unpredictable.

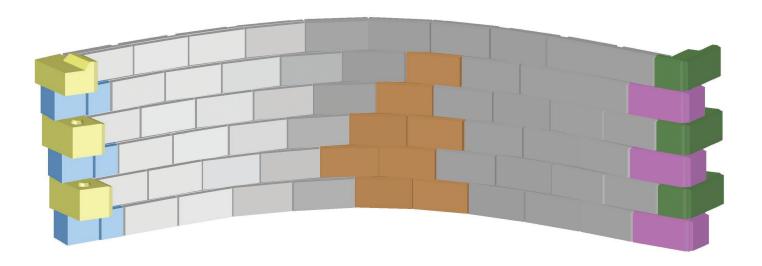


INSIDE-OUTSIDE

For straight walls, inside-outside corner pairings do not require the use of Key Blocks. However, when building a curve, the wall length changes because of the change in radius. This means Key Blocks will have to be introduced into the wall. The bottom of the wall will have the most Key Blocks, and less will be required moving up. Exactly how many Key Blocks will be needed is unpredictable and is different for every wall.

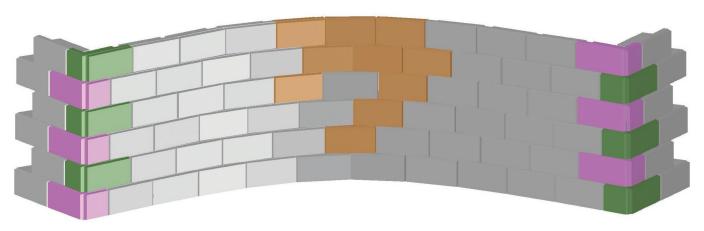

OUTSIDE-OUTSIDE

The outside-outside corner pairing is built quite differently than the inside-outside. Since both corners are outside corners, there is a need for Key Blocks as you proceed up a wall. However, because of the changing radius of each successive layer, there is unpredictability in how many Key Blocks will be needed.

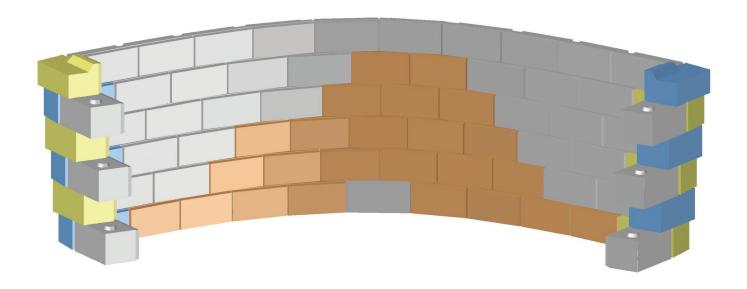


INSIDE-INSIDE

The inside-inside corner pairing is similar to the inside-outside corner pairing, as it requires more Key Blocks as you go down the wall. The inside-inside corner pairing is different, however, in that both the curvature of the wall and the corner insteps squeeze the wall in. Therefore, many Key Blocks will be used in the curve. For this reason a precise plan of the wall must be fashioned before construction.




OUTSIDE CURVES

Similar to inside curves, outside curves have the potential for many design problems. This is because of the changing radius of curves, regardless of the corner pairing. Dissimilar to inside curves, when each course steps back 2 inches the radius of your curve becomes smaller. This makes the length of each successive course slightly smaller. Due to the nature of curves, this change in length is very unpredictable.

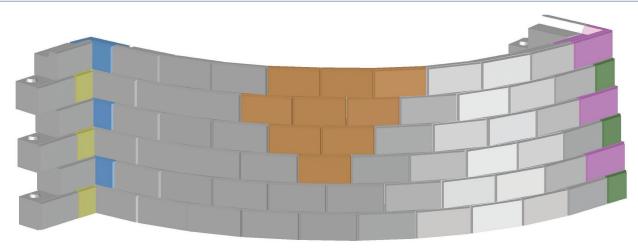


INSIDE-OUTSIDE

The bottom course of an inside-outside outside curve will require no Key Blocks. However, as the wall is built higher it begins to get squeezed, so Key Block must be introduced. Due to the nature of changing radii, exactly how many Key Blocks is unpredictable and differs on a case to case basis.

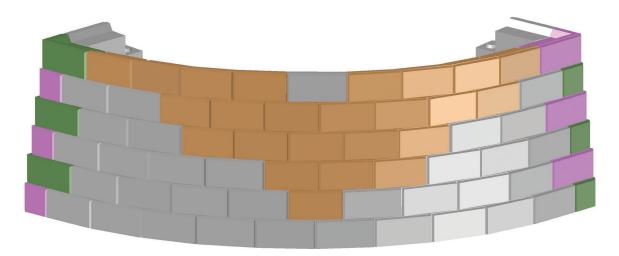

OUTSIDE-OUTSIDE

The outside-outside corner pairing uses the most Key Blocks of any outside curve corner pairing. Since the courses are squeezed both by changing radii and the corners, the wall will require many Key Blocks. The bottom layer will not require any Key Blocks, but you'll have to use more as the wall goes up. The exact number is unpredictable because of the changing radii.

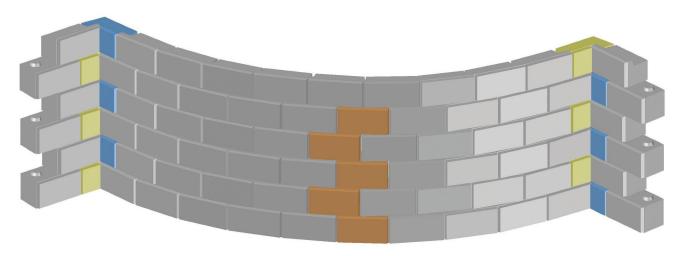

INSIDE-INSIDE


The inside-inside corner pairing requires more Key Blocks at the bottom of the wall than the top. This is because the inside corners squeeze the wall in. A precise plan of this wall must be fashioned before construction.



GRID REINFORCEMENT


FRICTION-FIT CONNECTION INSTALLATION*


Using no adhesives, grid reinforcement is held in place solely by the weight of the block above it. Place grid directly on top of the block, making sure to cover the knobs. Remember to stop your grid 2 in. short of the front of the block because the wall will be stepping back on the next course.



GEO-GRIP™ MECHANICAL CONNECTION INSTALLATION*

Using 12 in. wide grid lengths as designed by the assigned P.E. lay $\frac{1}{2}$ the length of grid strip on lower section of Geo-Grip connection and back in to wall. Loop grid through the patented Geo-Grip connection of each block. Be sure to have 4 inches of soil between the top and bottom layer of grid on each level. Lay the remaining $\frac{1}{2}$ grid on top of the soil back in to the wall.

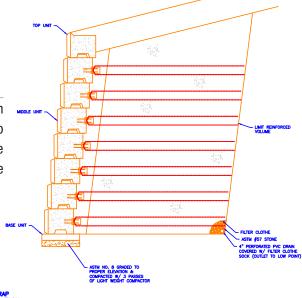

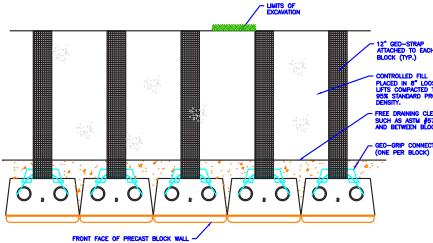


*NOTE

Be sure to follow manufacturers' instructions when placing grid. Also see grid installation estimation tables at the back of this manual.


CORNERS

Outside corners are simply made by overlapping the grid around the corner. Do not cut any of the grid. Inside corners by convention would have no overlapping of the grid. To make the wall secure, leave a small amount of grid going through the corner. This extra length should be 25% of the wall height. On the next course, do the same on the opposite side of the wall.

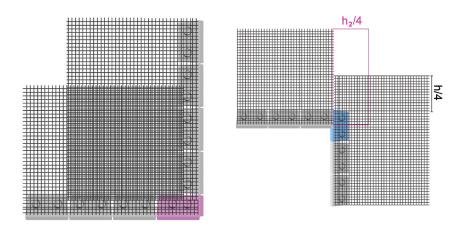


CURVES

Outside curves use standard, rectangular pieces of grid. Do not cut the grid, rather overlap each piece. Placing grid on inside curves will not cover the entire landscape behind it. To prevent problems, be sure to have grid covering these gaps on the next course.

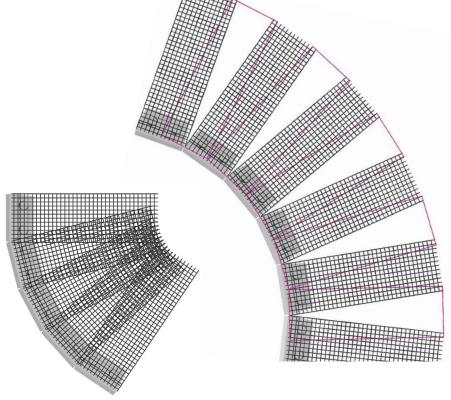


LEDGEROCK UNITS/NO SLOPE OR SURCHARGE

LEDGEROCK GEOSYNTHETIC REINFORCEMENT ESTIMATING CHARTS

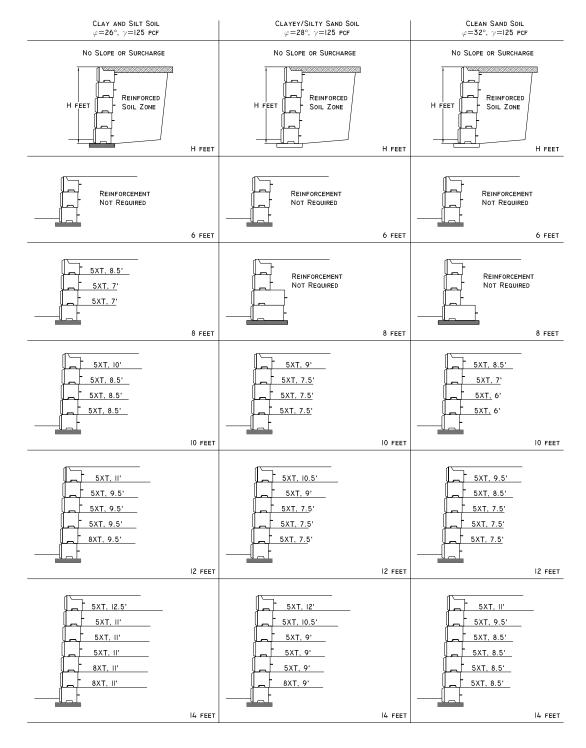


DETAIL SHOWN IS FOR COST ESTIMATING PURPOSES ONLY, AND SHOULD NOT BE USED FOR CONSTRUCTION WITHOUT THE SEAL OF A PROFESSIONAL ENGINEER LICENSED IN THE STATE THE PROJECT IS LOCATED.


LEDGEROCK UNITS/NO SLOPE OR SURCHARGE

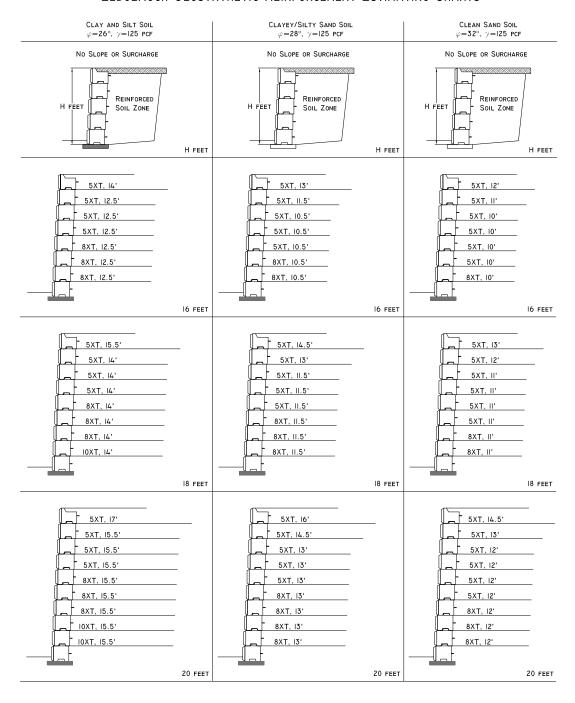


LEDGEROCK UNITS/250 PSF LIVE LOAD

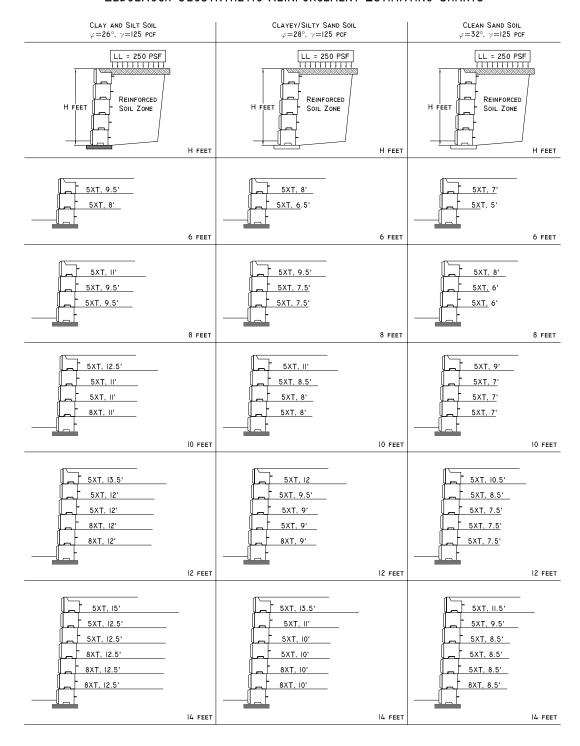


LEDGEROCK UNITS/250 PSF LIVE LOAD

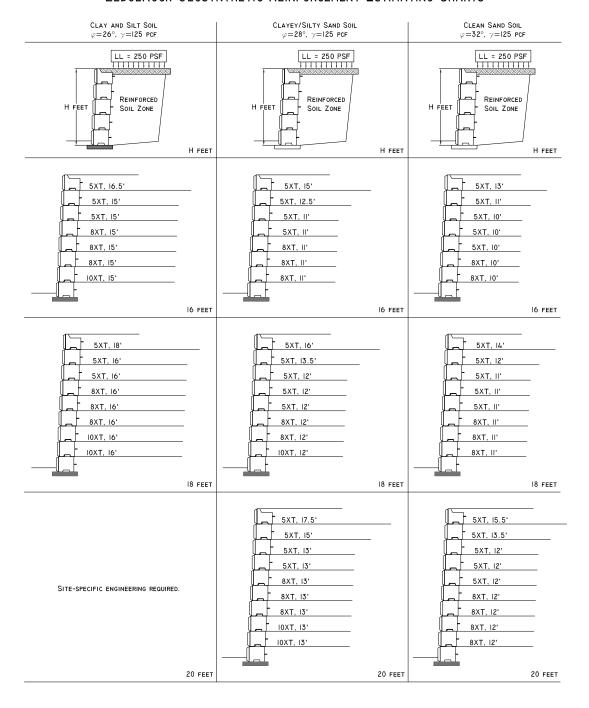

LEDGEROCK UNITS/3: | CREST SLOPE

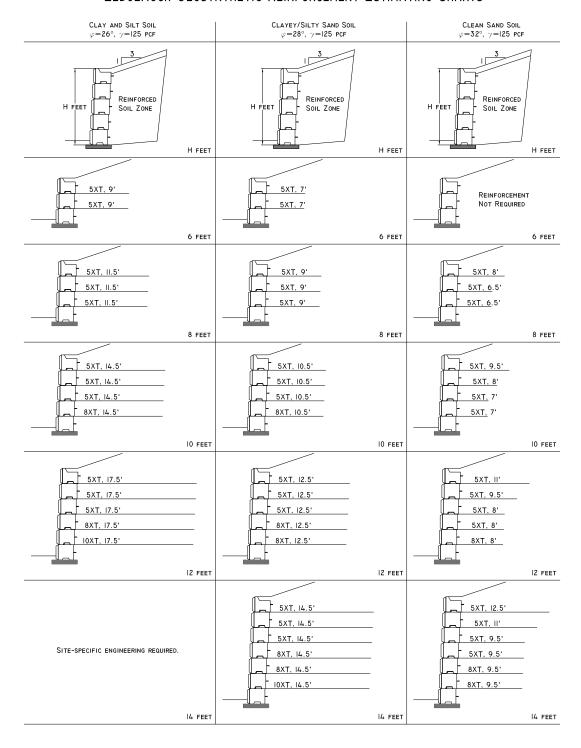


LEDGEROCK UNITS/3: | CREST SLOPE

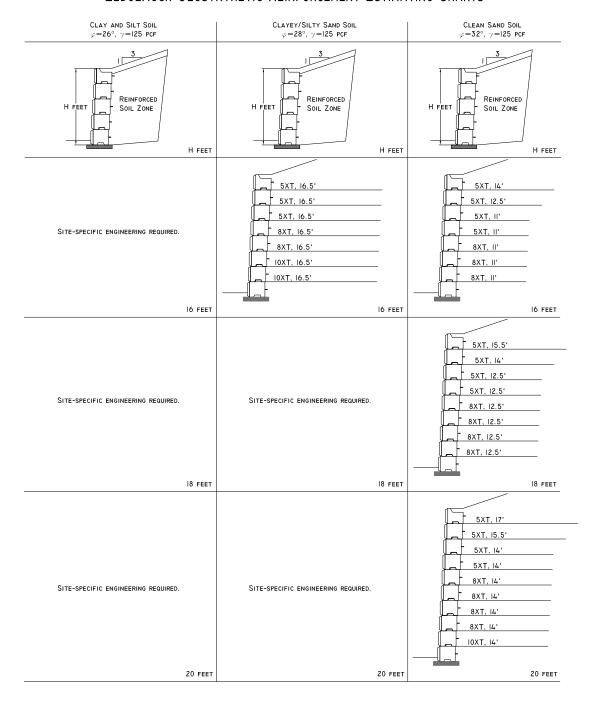


BASE BLOCKS

In some situations you may want to create a taller wall without soil reinforcement. Using 52" deep Base Blocks allows you to build taller walls without before requiring geogrid.



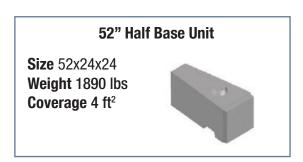


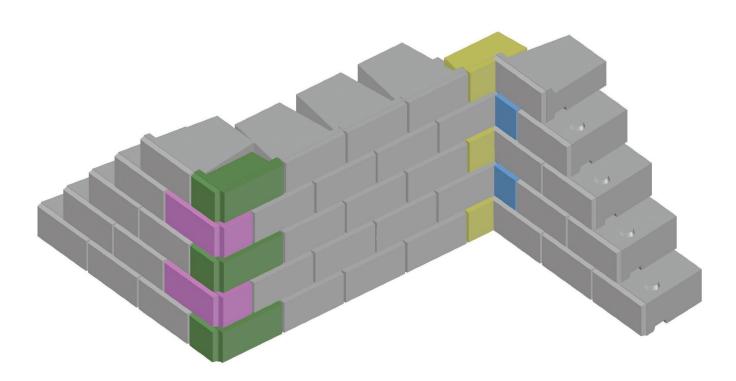

Base Block walls are constructed very similarly to standard Landscape Block walls. However, there is no need for Base corner blocks. Our standard Landscape Corner Blocks do the job.


STEPS

The most important thing to notice before building a stairwell is that after every four courses of steps, your stairwell will be 4 inches wider. This is because the wall is stepping back 2 inches on each side. You'll have to make your steps also 4 inches wider to account for this change in width.

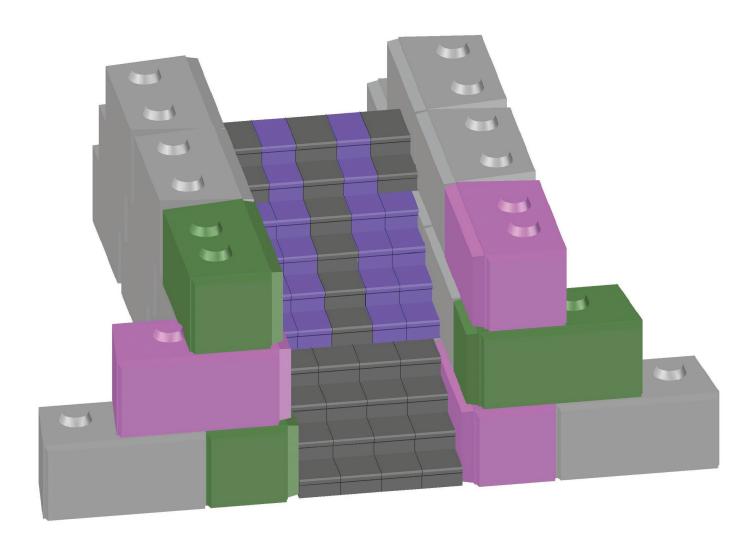

FENCING


The LedgeRock Fence Post Blockout holds a 6 inch concrete forming tube. This creates a void where a fence post can be set and anchored with concrete. Now you can create any type of fence that fits your needs. This fence uses 4x4's as posts, 2x4's and a 2x8 as railings, and 2x2's as slats.

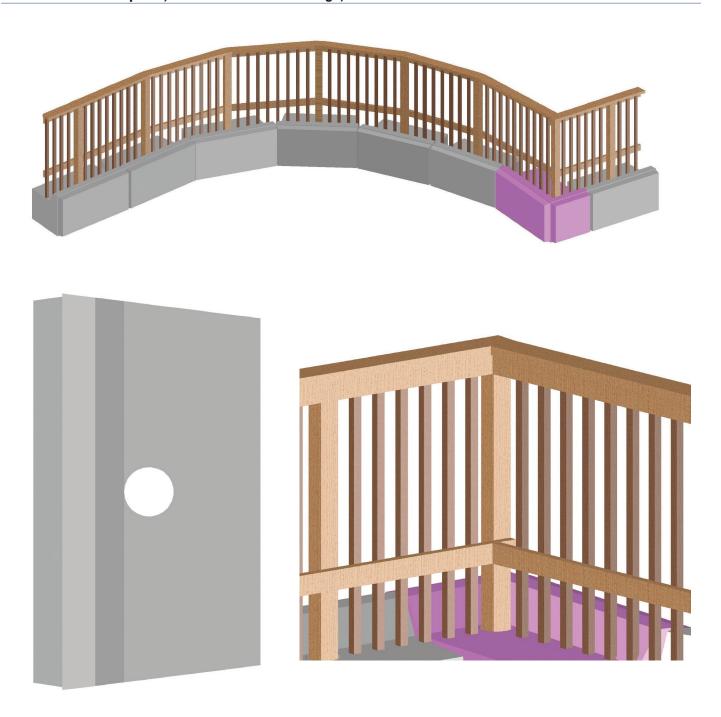

*NOTE
Call sales representative for availability.

TERRACING

When terracing a wall, always begin installation where the running bond pattern is intact; trying to join terraced courses to create a running bond can be very difficult. During installation, be sure to use Recess Blocks only when completely separated from the main wall.

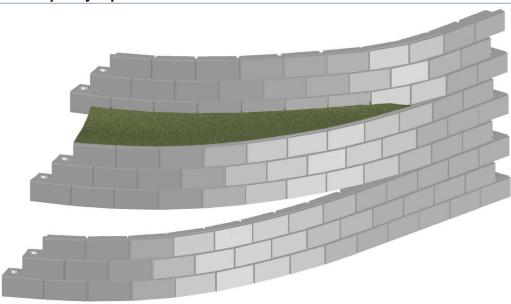

SEAWALLS


There are many ways to build a wall into water, and it is a job that is very site-specific. Before building any seawall, consult with a site engineer to ensure a safe design. Shown below, is a sample seawall. Included in its design is rip-rap, compacted aggregate, and filter fabric.



FINISHING OFF YOUR WALL

RECESS BLOCKS

Recess Blockouts create Recess Blocks which finish off your wall. Recess blocks are installed just like standard Full Units, but allow you to finish off your wall right to the block edge.

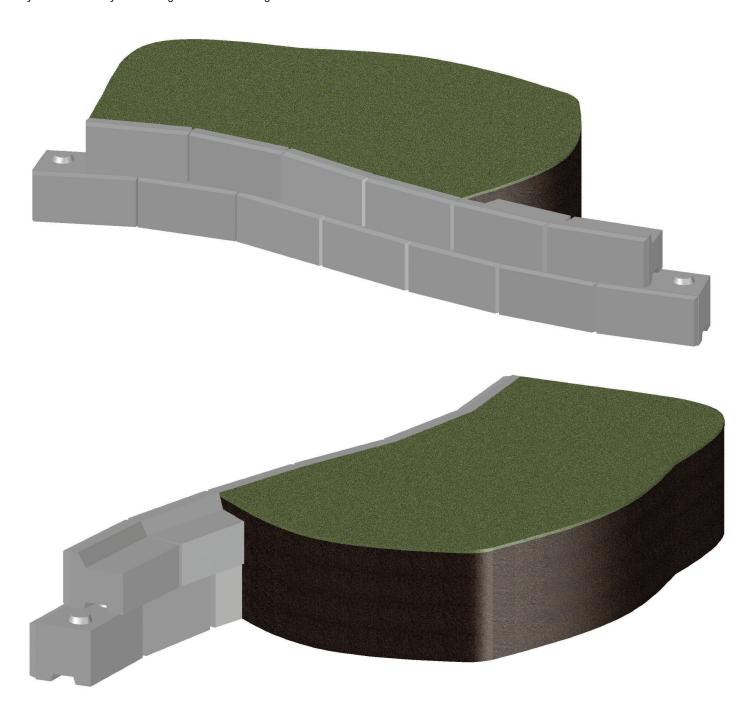


TOP CAPS

Although top caps give your wall a clean, finished look, many challenges can arise during installation. Top Caps are 48 inches on one side, and 42 inches on the other. For a straight wall every Cap must be rotated 180°. This breaks your running bond pattern as every other Cap has its short face to the front. You may need to cut the last Cap on your wall as it will likely hang off the edge.



Using Top Caps to complete a curved wall requires more labor than Recess Blocks. It is very likely that Top Caps will not match the curvature of your wall. This means you will have to cut the ends of every Top Cap to match the wall's curvature.

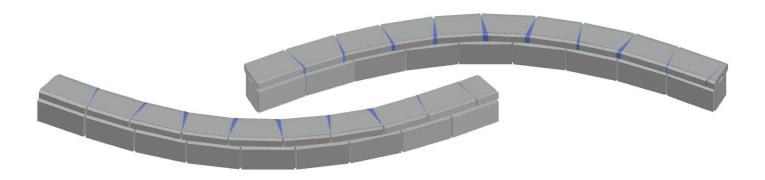



PRODUCT SPECIFICATION GUIDE

Specifier Notes: This product guide specification is written according to the Construction Specifications Institute (CSI) 3-Part Format, including MasterFormat, SectionFormat, and PageFormat, as described in The Project Resource Manual—CSI Manual of Practice, Fifth Edition.

This section must be carefully reviewed and edited by the Architect or Engineer to meet the requirements of the project and local building code. Coordinate this section with other specification sections and the Drawings. Delete all "Specifier Notes" after editing this section.

Section numbers are from MasterFormat 2010 Update.

SECTION 32 32 16 PRECAST MODULAR BLOCK WALLS

Specifier Notes: This section covers retaining walls made from Standard Precast Modular Block Units (PMB). PMB's are manufactured by Amcon Concrete Products. Consult Amcon Concrete Products for assistance in editing this section for the specific application.

PART 1 GENERAL 1.1 SECTION INCLUDES

A. Precast Modular Block retaining walls.

1.2 RELATED REQUIREMENTS

Specifier Notes: Edit the following list of related sections as required. Limit the list to sections with specific information that the reader might expect to find in this section, but is specified elsewhere.

- A. Section 03 40 00 Precast Concrete: Concrete for landscape blocks.
- **B.** Section 33 46 33 Retaining Wall Drainage.

1.3 REFERENCE STANDARDS

Specifier Notes: List standards referenced in this section, complete with designations and titles. Delete standards not included in the edited section. Including a standard in this list does not require compliance with that standard.

A. AASHTO M288 – Standard Specification for Geotextile Specification for Highway Applications.

- B. ASTM D 422 Standard Test Method for Particle-Size Analysis of Soils.
- C. ASTM D 698 Standard Test Methods for Laboratory Compaction Characteristics of Soil Using Standard Effort (12 400 ft-lbf/ft3 (600 kN-m/m3)).
- D. ASTM D 1248 Standard Specification for Polyethylene Plastics Extrusion Materials For Wire and Cable.
- E. ASTM C 1776 Standard Specification for West-Cast Precast Modular Retaining Wall Units.
- F. ASTM D 3034 Standard Specification for Type PSM Poly(Vinyl Chloride) (PVC) Sewer Pipe and Fittings.
- **G.** ASTM D 4355 Standard Test Method for Deterioration of Geotextiles by Exposure to Light, Moisture and Heat in a Xenon Arc Type Apparatus.
- H. ASTM D 4491 Standard Test Methods for Water Permeability of Geotextiles by Permittivity.
- **I.** ASTM D 4533 Standard Test Method for Trapezoid Tearing Strength of Geotextiles.
- J. ASTM D 4632 Standard Test Method for Grab Breaking Load and Elongation of Geotextiles.
- K. ASTM D 4751 Standard Test Method for Determining Apparent Opening Size of a Geotextile.
- L. ASTM D 5199 Standard Test Method for Measuring the Nominal Thickness of Geosynthetics.
- M. ASTM D 5261 Standard Test Method for Measuring Mass per Unit Area of Geotextiles.
- N. ASTM D 5262 Standard Test Method for Evaluating the Unconfined Tension Creep and Creep Rupture Behavior of Geosynthetics.
- ASTM D 6241 Standard Test Method for the Static Puncture Strength of Geotextiles and Geotextile-Related Products Using a 50-mm Probe.
- P. ASTM D 6637 Standard Test Method for Determining Tensile Properties of Geogrids by the Single or Multi-Rib Ten sile Method.
- Q. Geosynthetic Research Institute (GRI) GG4(b) Standard Practice for Determination of the Long-Term Design Strength of Flexible Geogrids.

1.4 PREINSTALLATION MEETINGS

Specifier Notes: Edit preinstallation meetings as necessary. Delete if not required.

- A. Convene preinstallation meeting 2 weeks before start of installation of precast modular block retaining walls.
- **B.** Require attendance of parties directly affecting work of this section, including Contractor, Architect, Engineer, and installer.
- **C.** Review the following:
 - 1. Materials.
 - 2. Excavation.
 - 3. Installation.
 - 4. Tolerances.
 - 5. Field quality control.
 - 6. Protection.
 - 7. Coordination with other work.

1.5 SUBMITTALS

Specifier Notes: Edit submittal requirements as necessary. Delete submittals not required.

- A. Comply with Section 01 33 00 Submittal Procedures.
- **B.** Product Data: Submit manufacturer's product data for the following:
 - 1. Precast modular blocks.
 - 2. Geogrid soil reinforcement.
 - 3. Drainage collection pipe.
 - 4. Geotextile filter fabric.
- **c.** Reinforced Backfill: Submit reinforced backfill sample and laboratory test results to Engineer for approval before use of proposed reinforced backfill material.
- **D.** Installer's Project References: Submit installer's list of successfully completed retaining wall projects, including project name and location, names of architect and engineer, and type and size of retaining walls installed.

1.6 QUALITY ASSURANCE

- A. Installer's Qualifications:
 - 1. Installer regularly engaged, for past 5 years, in installation of retaining walls of similar type and size to that specified.
 - 2. Employ persons trained for installation of retaining walls.

1.7 DELIVERY, STORAGE, AND HANDLING

- A. Delivery and Acceptance Requirements: Deliver materials to site with labels clearly identifying product name and manufacturer.
- **B.** Storage and Handling Requirements:
 - 1. Store and handle materials in accordance with manufacturer's instructions.
 - 2. Keep materials in manufacturer's original, unopened containers and packaging until installation.
 - 3. Protect materials during storage, handling, and installation to prevent damage.

PART 2 PRODUCTS **DESIGN CRITERIA**

Specifier Notes: Backfill soil and base soil properties vary greatly from site to site. An engineering analysis of soil properties should be performed for each retaining wall installation. The Engineer should edit the following paragraph for the specific application.

A. Assumed Soil Properties:

- 1. Backfill Soil:
 - a. Soil Type: Poorly graded sand and gravel, well drained, Class SP.
 - b. Soil Unit Weight: 110 pcf.
 - c. Internal Soil Friction Angle: 30 degrees.
 - d. Wall-Soil Friction Angle: 20.1 degrees.
- 2. Base Soil:
 - a. Soil Type: Gravel well drained and compacted.
 - b. Soil Unit Weight: 125 pcf.
 - c. Internal Soil Friction Angle: 38 degrees.
- B. Precast modular blocks:
 - 1. Concrete Unit Weight: 150 pcf.
 - 2. Average Compressive Strength: 4,300 psi.
 - 3. Concrete-Soil Friction Factor: 0.67.
- C. Factor of Safety Assumptions:
 - 1. Retaining Wall Sliding: 1.5.
 - 2. Retaining Wall Overturning: 2.0.
 - 3. Soil Bearing Capacity: 3.0.

PRECAST MODULAR BLOCKS

A. Precast Modular Blocks:

- 1. Interlocking, precast modular blocks in shapes and sizes as indicated on the Drawings to create complete concrete landscape block retaining walls.
- 2. Exposed stone face.
- 3. Step back 2 inches on every course.

■ INSTALLATION AND ENGINEERING MANUAL

Specifier Notes: Concrete landscape block forms manufactured by Amcon Concrete Products may contribute in achieving LEED certification by providing points in the following categories:

Materials and Resources:

Credit 3: Materials Reuse

Credit 4: Recycled Content

Credit 5: Regional Materials

Consult Amcon Concrete Products for additional information.

- **1.** Manufacturer: Amcon Concrete Products, 2025 Centre Pointe Blvd, Suite 300, Mendota Heights, MN 55120 Phone 651-688-9116 Fax 651-688-9164 www.amconconcreteproducts.com info@amconconcreteproducts.com
- 2. Form Material: Steel.
- 3. Nominal Dimensions of Basic Full Block: 24 inches by 24 inches by 48 inches.
- 4. Complete selection of precast modular block form categories, including:
 - a. Basic block forms.
 - b. Corner block forms.
 - c. Recess blockout forms.
 - d. Cap forms.
 - e. Step forms.
 - f. Key block forms.
 - g. Base block forms.
 - h. Form Liners: Creates exposed stone face.
 - i. Concrete for Landscape Blocks:
- 5. Minimum Compressive Strength: 4,300 psi at 28 days.

Specifier Notes: When the retaining wall project is at a location with freeze/thaw cycles, the Engineer will determine the air content of the concrete.

- 1. Air Content: [______ percent] [Determined by Engineer].
- 2. Precast Concrete: Specified in Section 03 40 00.

2.3 SOIL

- A. Base Leveling Pad Material: Compacted crushed stone base or nonreinforced concrete as indicated on the Drawings.
- B. Drainage Fill:
 - 1. Clean, 1-inch-minus crushed stone or crushed gravel.
 - 2. Gradation, ASTM D 422:
 - a. 1-inch Sieve Size: 100 percent passing.
 - b. 3/4-inch Sieve Size: 75 to 100 percent passing.
 - c. No. 4 Sieve Size: 0 to 10 percent passing.
 - d. No. 50 Sieve Size: 0 to 5 percent passing.
 - 3. Use minimum of 1 cubic foot of drainage fill for each square foot of retaining wall face.
 - 4. Place drainage fill between and behind precast modular blocks.
- C. Reinforced Backfill:
 - 1. Clean.
 - 2. Gradation, ASTM D 422:
 - a. 2-inch Sieve Size: 75 to 100 percent passing.
 - b. 3/4-inch Sieve Size: 75 to 100 percent passing.
 - c. No. 40 Sieve Size: 0 to 60 percent passing.
 - d. No. 200 Sieve Size: 0 to 35 percent passing.
 - **3.** Maximum Aggregate Size: 3/4 inch, unless field tests performed to evaluate potential strength reductions to geogrid soil reinforcement design due to damage during construction.
 - Site Excavated Soils: Acceptable when specified requirements can be met.
 - 5. Do not use unsuitable soils, including high-plastic clays or organic soils, for backfill or in reinforced soil mass.

2.4 GEOGRID SOIL REINFORCEMENT

Specifier Notes: The Engineer should specify the geogrid soil reinforcement for the specific application. Specify one of the following three types of geogrid.

- A. Geogrid Soil Reinforcement: TenCate Mirafi "Miragrid 5XT".
 - 1. Description:
 - a. High-molecular-weight, high-tenacity polyester multifilament yarns woven in tension and finished with PVC coating.
 - b. Inert to biological degradation.
 - c. Resistant to naturally encountered chemicals, alkalis, and acids.

- 2. Mechanical Properties, Minimum Average Roll Value, Machine Direction:
 - a. Tensile Strength at Ultimate, ASTM D 6637: 4,700 lbs/ft (68.6 kN/m).
 - b. Tensile Strength at 5 Percent Strain, ASTM D 6637: 1,740 lbs/ft (25.4 kN/m).
 - c. Creep Reduced Strength, ASTM D 5262: 2,975 lbs/ft (43.4 kN/m).
 - d. Long-Term Allowable Design Load, GRI GG4(b): 2,575 lbs/ft (37.6 kN/m).
- 3. Physical Properties:
 - a. Grid Aperture Size:
 - 1) Machine Direction: 1.2 inch (30.5 mm).
 - 2) Cross-Machine Direction: 1.0 inch (25.4 mm).
 - b. Mass/Unit Area, ASTM D 5261: 9.0 oz/sq yd (305.1 g/m2).
 - c. Roll Dimensions, Width by Length: 12 feet by 150 feet (3.6 m by 45.7 m).
 - d. Geogrid Soil Reinforcement: TenCate Mirafi "Miragrid 8XT".
- 1. Description:
 - **a.** High-molecular-weight, high-tenacity polyester multifilament yarns woven in tension and finished with PVC coating.
 - **b.** Inert to biological degradation.
 - c. Resistant to naturally encountered chemicals, alkalis, and acids.
- 2. Mechanical Properties, Minimum Average Roll Value, Machine Direction:
 - a. Tensile Strength at Ultimate, ASTM D 6637: 7,400 lbs/ft (108.0 kN/m).
 - **b.** Tensile Strength at 5 Percent Strain, ASTM D 6637: 2,520 lbs/ft (36.8 kN/m).
 - c. Creep Reduced Strength, ASTM D 5262: 4,684 lbs/ft (68.3 kN/m).
 - d. Long-Term Allowable Design Load, GRI GG4(b): 4,055 lbs/ft (59.2 kN/m).
- 3. Physical Properties:
 - a. Grid Aperture Size:
 - 1) Machine Direction: 1.3 inches (33.0 mm).
 - 2) Cross-Machine Direction: 0.9 inch (21.8 mm).
 - **b.** Mass/Unit Area, ASTM D 5261: 10.8 oz/sq vd (366 g/m2).
 - c. Roll Dimensions, Width by Length: 12 feet by 200 feet (3.6 m by 61 m).
- C. Geogrid Soil Reinforcement: TenCate Mirafi "Miragrid 10XT".
 - 1. Description:
 - **a.** High-molecular-weight, high-tenacity polyester multifilament yarns woven in tension and finished with PVC coating.
 - **b.** Inert to biological degradation.
 - c. Resistant to naturally encountered chemicals, alkalis, and acids.

LEDGEROCK

- 2. Mechanical Properties, Minimum Average Roll Value, Machine Direction:
 - a. Tensile Strength at Ultimate, ASTM D 6637: 9,500 lbs/ft (138.6 kN/m).
 - b. Tensile Strength at 5 Percent Strain, ASTM D 6637: 3,120 lbs/ft (45.5 kN/m).
 - c. Creep Reduced Strength, ASTM D 5262: 6,013 lbs/ft (87.7 kN/m).
 - d. Long-Term Allowable Design Load, GRI GG4(b): 5,206 lbs/ft (76.0 kN/m).
- 3. Physical Properties:
 - a. Grid Aperture Size:
 - 1) Machine Direction: 1.3 inches (33.3 mm).
 - 2) Cross-Machine Direction: 0.8 inch (20.8 mm).
 - b. Mass/Unit Area, ASTM D 5261: 13.3 oz/sq yd (451 g/m2).
 - c. Roll Dimensions, Width by Length: 12 feet by 200 feet (3.6 m by 61 m).

2.5 GEOTEXTILE FILTER FABRIC

Specifier Notes: The Engineer should specify the geotextile filter fabric for the specific application.

- A. Geotextile Filter Fabric: TenCate Mirafi "Mirafi 140N".
 - 1. Description:
 - **a.** Needlepunched, nonwoven geotextile with polypropylene fibers formed into stable network such that fibers retain relative position.
 - **b.** Inert to biological degradation.
 - c. Resistant to naturally encountered chemicals, alkalis, and acids.
 - 2. Compliance: AASHTO M288, Class 3 for elongation greater than 50 percent.
 - 3. Mechanical Properties, Minimum Average Roll Value:
 - a. Grab Tensile Strength, ASTM D 4632:
 - 1) Machine Direction: 120 lbs (534 N).
 - 2) Cross-Machine Direction: 120 lbs (534 N).
 - b. Grab Tensile Elongation, ASTM D 4632:
 - 1) Machine Direction: 50 percent.
 - 2) Cross-Machine Direction: 50 percent.
 - c. Trapezoid Tear Strength, ASTM D 4533:
 - 1) Machine Direction: 50 lbs (223 N).
 - 2) Cross-Machine Direction: 50 lbs (223 N).

- d. CBR Puncture Strength, ASTM D 6241: 300 lbs (1,335 N).
- e. Apparent Opening Size (AOS), ASTM D 4751: 70 US Sieve (0.212 mm).
- f. Permittivity, ASTM D 4491: 1.7 sec-1.
- g. Flow Rate, ASTM D 4491: 135 gal/min/sq ft (5,500 L/min/m2).
- h. UV Resistance, 500 Hours, ASTM D 4355: 70 percent strength retained.
- 4. Physical Properties:
 - a. Weight, ASTM D 5261: 4.8 oz/sq yd (163 g/m2).
 - **b.** Thickness, ASTM D 5199: 40 mils (1.0 mm).
 - c. Roll Dimensions, Width by Length:
 - 1) 12.5 feet by 360 feet (3.8 m by 110 m).
 - 2) 15 feet by 360 feet (4.5 m by 110 m).

2.6 DRAINAGE COLLECTION PIPE

- A. Drainage Collection Pipe:
 - 1. PVC, ASTM D 3034 or corrugated HDPE, ASTM D 1248 pipe.
 - 2. Perforated or slotted.

PART 3 EXECUTION 3.1 EXAMINATION

- A. Examine areas to receive precast modular block retaining walls.
- B. Notify Architect of conditions that would adversely affect excavation or installation.
- **C.** Do not begin excavation or installation until unacceptable conditions are corrected.

3.2 GENERAL

A. Construct precast modular block retaining walls to lines, grades, dimensions, design, and pattern indicated on the Drawings.

3.3 EXCAVATION

- A. Excavate to lines and grades indicated on the Drawings.
- B. Owner's representative will inspect excavation and approve before placement of leveling material or backfill.
- **C.** Proofroll foundation area as directed to determine if remedial work is required.
- **D.** Following excavation for leveling pad and reinforced soil zone, soil will be examined by Engineer to assure actual foundation soil strength meets or exceeds assumed design bearing strength.
- E. Remove and replace soils not meeting required strength with soil meeting design criteria, as directed by Engineer.

3.4 BASE LEVELING PAD

- A. Place Leveling Pad Material to:
 - 1. Lines and grades indicated on the Drawings.
 - 2. Minimum thickness of 6 inches.
 - 3. Extend laterally a minimum of 6 inches in front and behind precast modular blocks.
- **B.** Compact soil leveling pad material to a minimum of 95 percent of maximum Standard Proctor density in accordance with ASTM D 698.
- **C.** Prepare leveling pad to ensure full contact with base surface of precast modular blocks.

3.5 PRECAST MODULAR BLOCK INSTALLATION

- A. Install precast modular blocks in accordance with precast modular block manufacturer's instructions.
- **B.** Place first course of precast modular blocks on leveling pad at proper line and grade.
- **C.** Check alignment and level in all directions.
- **D.** Ensure precast modular blocks are in full contact with base and properly seated.
- **E.** Place front of precast modular blocks side-by-side.
- F. Do not leave gaps between adjacent blocks.
- G. Layout corners and curves in accordance with precast modular block manufacturer's instructions.
- H. Place and compact drainage fill within and behind precast modular blocks.
- I. Place and compact backfill soil behind drainage fill.
- J. Follow retaining wall erection and drainage fill closely with structure backfill.
- **K.** Do not exceed 1 course of stacked vertical height of precast modular blocks, before drainage fill and backfill placement and compaction.

3.6 GEOTEXTILE FILTER FABRIC

- A. Install geotextile filter fabric in accordance with geotextile filter fabric manufacturer's instructions.
- **B.** Wrap drainage collection pipe and drainage aggregate with geotextile filter fabric.

3.7 GEOGRID SOIL REINFORCEMENT INSTALLATION

- A. Install geogrid soil reinforcement in accordance with geogrid soil reinforcement manufacturer's instructions.
- **B.** Install geogrid soil reinforcement at location, elevation, length, and orientation as indicated on the Drawings or as directed by Engineer.
- C. Orient geogrid soil reinforcement with highest strength axis perpendicular to retaining wall alignment.
- **D.** Lay geogrid soil reinforcement horizontally on compacted backfill and attach to precast modular blocks.

- E. Place next course of precast modular blocks over geogrid soil reinforcement.
- F. Pull geogrid soil reinforcement taut, free of wrinkles and anchor before backfill placement on geogrid soil reinforcement.
- **G.** Ensure geogrid soil reinforcement is continuous throughout embedment length and is placed side-by-side to provide 100 percent coverage at each level.
- H. Do not splice connections between shorter pieces of geogrid soil reinforcement.
- **I.** Do not allow gaps between adjacent pieces of geogrid soil reinforcement.

3.8 REINFORCED BACKFILL PLACEMENT

- A. Place, spread, and compact reinforced backfill to minimize slack in geogrid soil reinforcement and installation damage.
- **B.** Place and compact reinforced backfill in maximum 6-inch lifts where hand compaction is used or maximum 8 to 10-inch lifts where heavy compaction equipment is used.
- C. Decrease lift thickness to achieve required density, if necessary.
- D. Compact reinforced backfill to 95 percent of maximum density in accordance with ASTM D 698.
- **E.** Ensure moisture content of reinforced backfill before and during compaction is uniformly distributed throughout each layer and is dry of optimum, plus 0 percent, minus 3 percent.
- F. Construction Equipment:
 - 1. Allow only lightweight hand-operated equipment within 3 feet from soil side of precast modular blocks.
 - 2. Do not operate tracked construction equipment directly on geogrid soil reinforcement.
 - 3. Provide minimum backfill thickness of 6 inches before operation of tracked vehicles over geogrid soil reinforcement.
 - **4.** Keep tracked vehicle turning to a minimum to prevent tracks from displacing backfill and damaging geogrid soil reinforcement.
 - 5. Do not allow rubber-tired equipment to pass over geogrid soil reinforcement at speeds greater than 10 mph.
 - 6. Avoid sudden braking and sharp turning with rubber-tired equipment.
 - **7.** Slope last lift of reinforced backfill away from precast modular blocks to direct runoff away from retaining wall face, at end of each day's operation.
- G. Do not allow surface runoff from adjacent areas to enter retaining wall construction site.

3.9 TOLERANCES

- A. Retaining Wall Vertical Alignment: Plus or minus 1.5 inches over any 10-foot distance.
 - 1. Retaining Wall Batter: Plus or minus 2 degrees of design batter.
- B. Retaining Wall Horizontal Alignment: Plus or minus 1.5 inches over any 10-foot distance.
 - 1. Corners, Bends, and Curves: Plus or minus 1 foot to theoretical location.
- C. Maximum Horizontal Gap Between Precast Modular Blocks: 1/2 inch.

3.10 FIELD QUALITY CONTROL

Specifier Notes: Specify field quality control to be performed by the Owner and the Contractor. Edit the following as required.

- **A.** Owner's Field Quality Control: Owner will engage inspection and testing services, including independent laboratories, to provide quality assurance and testing services during construction.
- **B.** Contractor's Field Quality Control:
 - 1. Perform necessary field quality control testing during construction using qualified and experienced personnel.
 - 2. Include the following as a minimum:
 - a. Foundation soil inspection.
 - **b.** Soil and backfill testing.
 - c. Verification of design parameters.
 - **d.** Observation of construction for general compliance with the Drawings and specifications.

3.11 PROTECTION

A. Protect installed precast modular block retaining walls to ensure that, except for normal weathering, retaining walls will be without damage or deterioration at time of Substantial Completion.

Notes:			

■ INSTALLATION AND ENGINEERING MANUAL

Notes:

LEDGEROCK.

Notes:			

